


NOTE:

1. SECURELY FASTEN CONDUIT AND METERBASE/DISCONNECT SWITCH TO POLE.
3. IF SERVICE LINE IS GREATER THAN 90' IN LENGTH THEN A GUYING KIT IS REQUIRED.
4. POLE TO BE 6"x6"x25' TALL PRESSURE TREATED, PROVIDED BY AND IS PROPERTY OF OWNER.

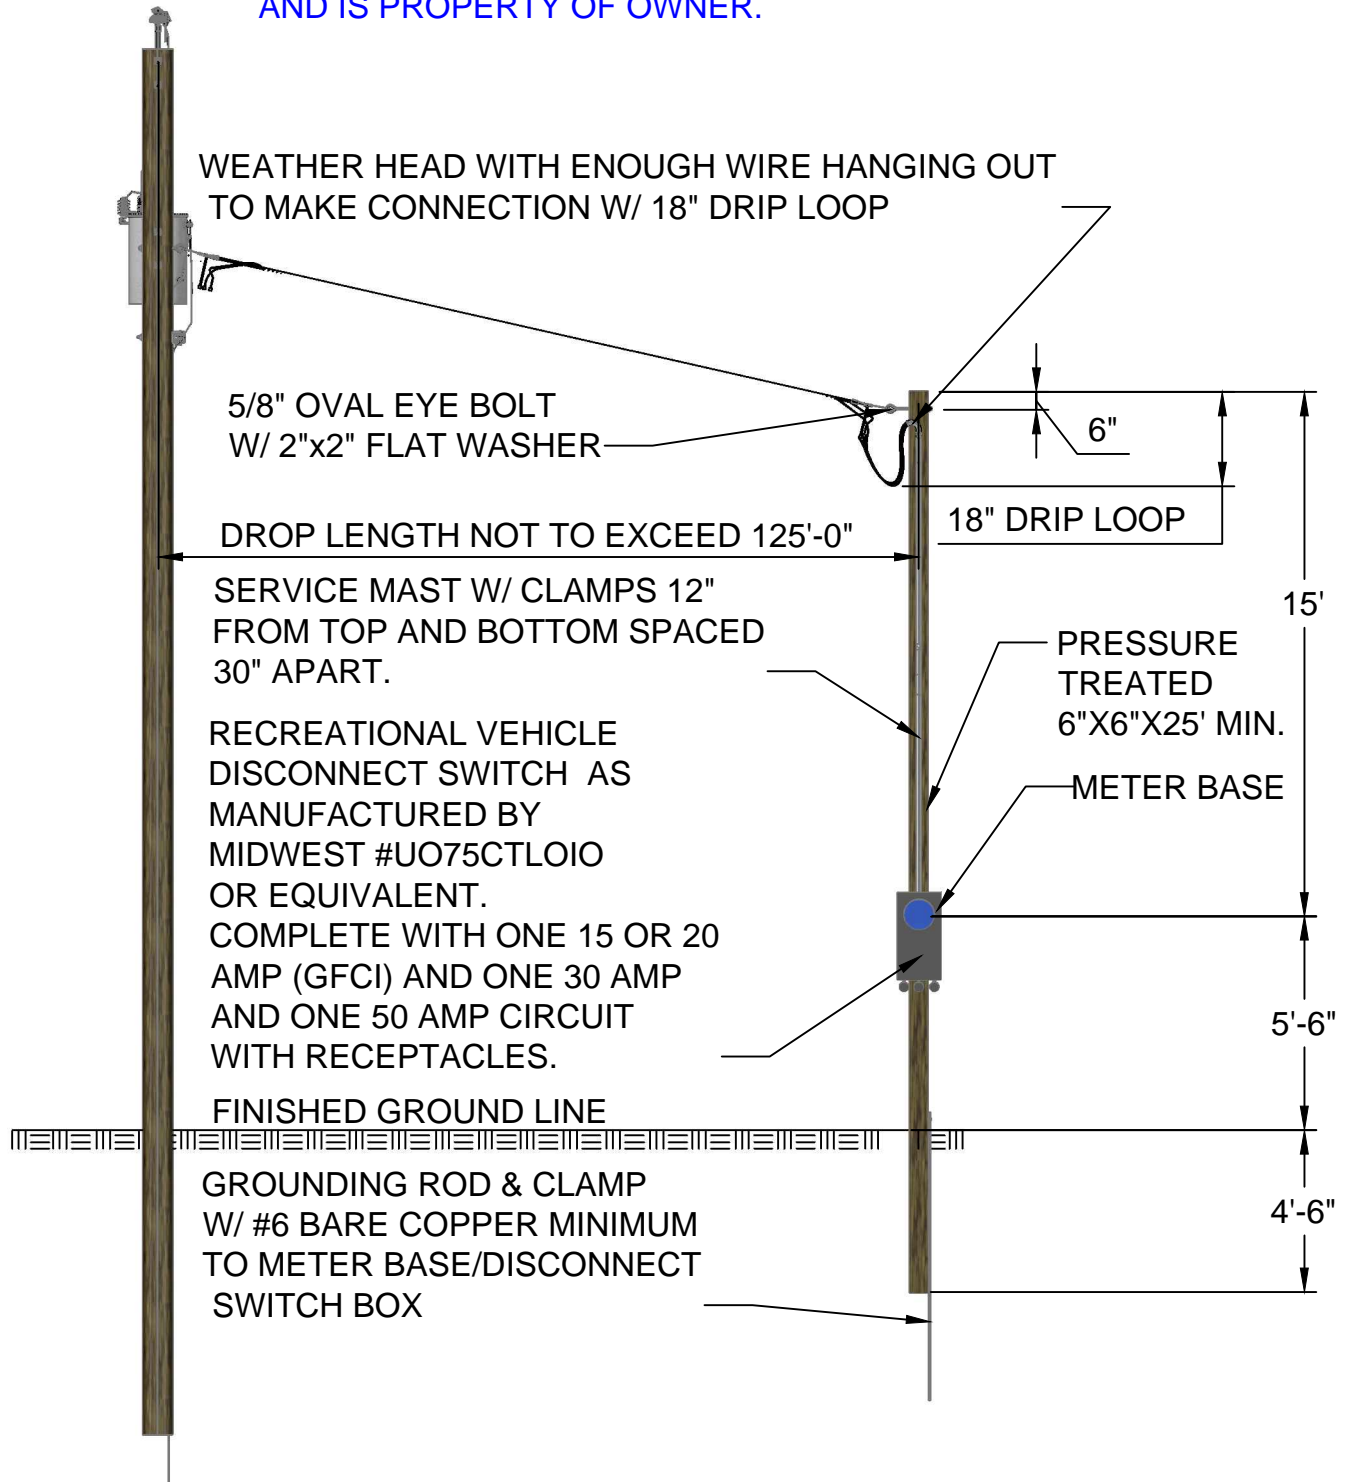

| | | | | |
|---|-------------|---------------------|-----------------------------|-----------------------|
| COMPANY: ELIZABETHTON ELECTRIC DEPARTMENT | | | | M8-6 |
| DETAIL NAME: RECREATIONAL VEHICLE SERVICE PRIVATE POLE MATERIALS TO BE SUPPLIED BY BUILDER/OWNER | | | | |
| DRAWN BY: J.E.S. | CHECKED BY: | DATE: 07/01/2010 | PURPOSE: ASSEMBLY DETAIL | SCALE: 3/16"=1'-0" |
| | | | PAGE: 6 | PAGES: OF 11 |