


NOTE:

1. SECURELY FASTEN CONDUIT AND METER BASE/DISCONNECT SWITCH TO POLE..
2. LOCATION OF UNDERGROUND TEMPORARIES TO BE DETERMINED BY EED ENGINEER.

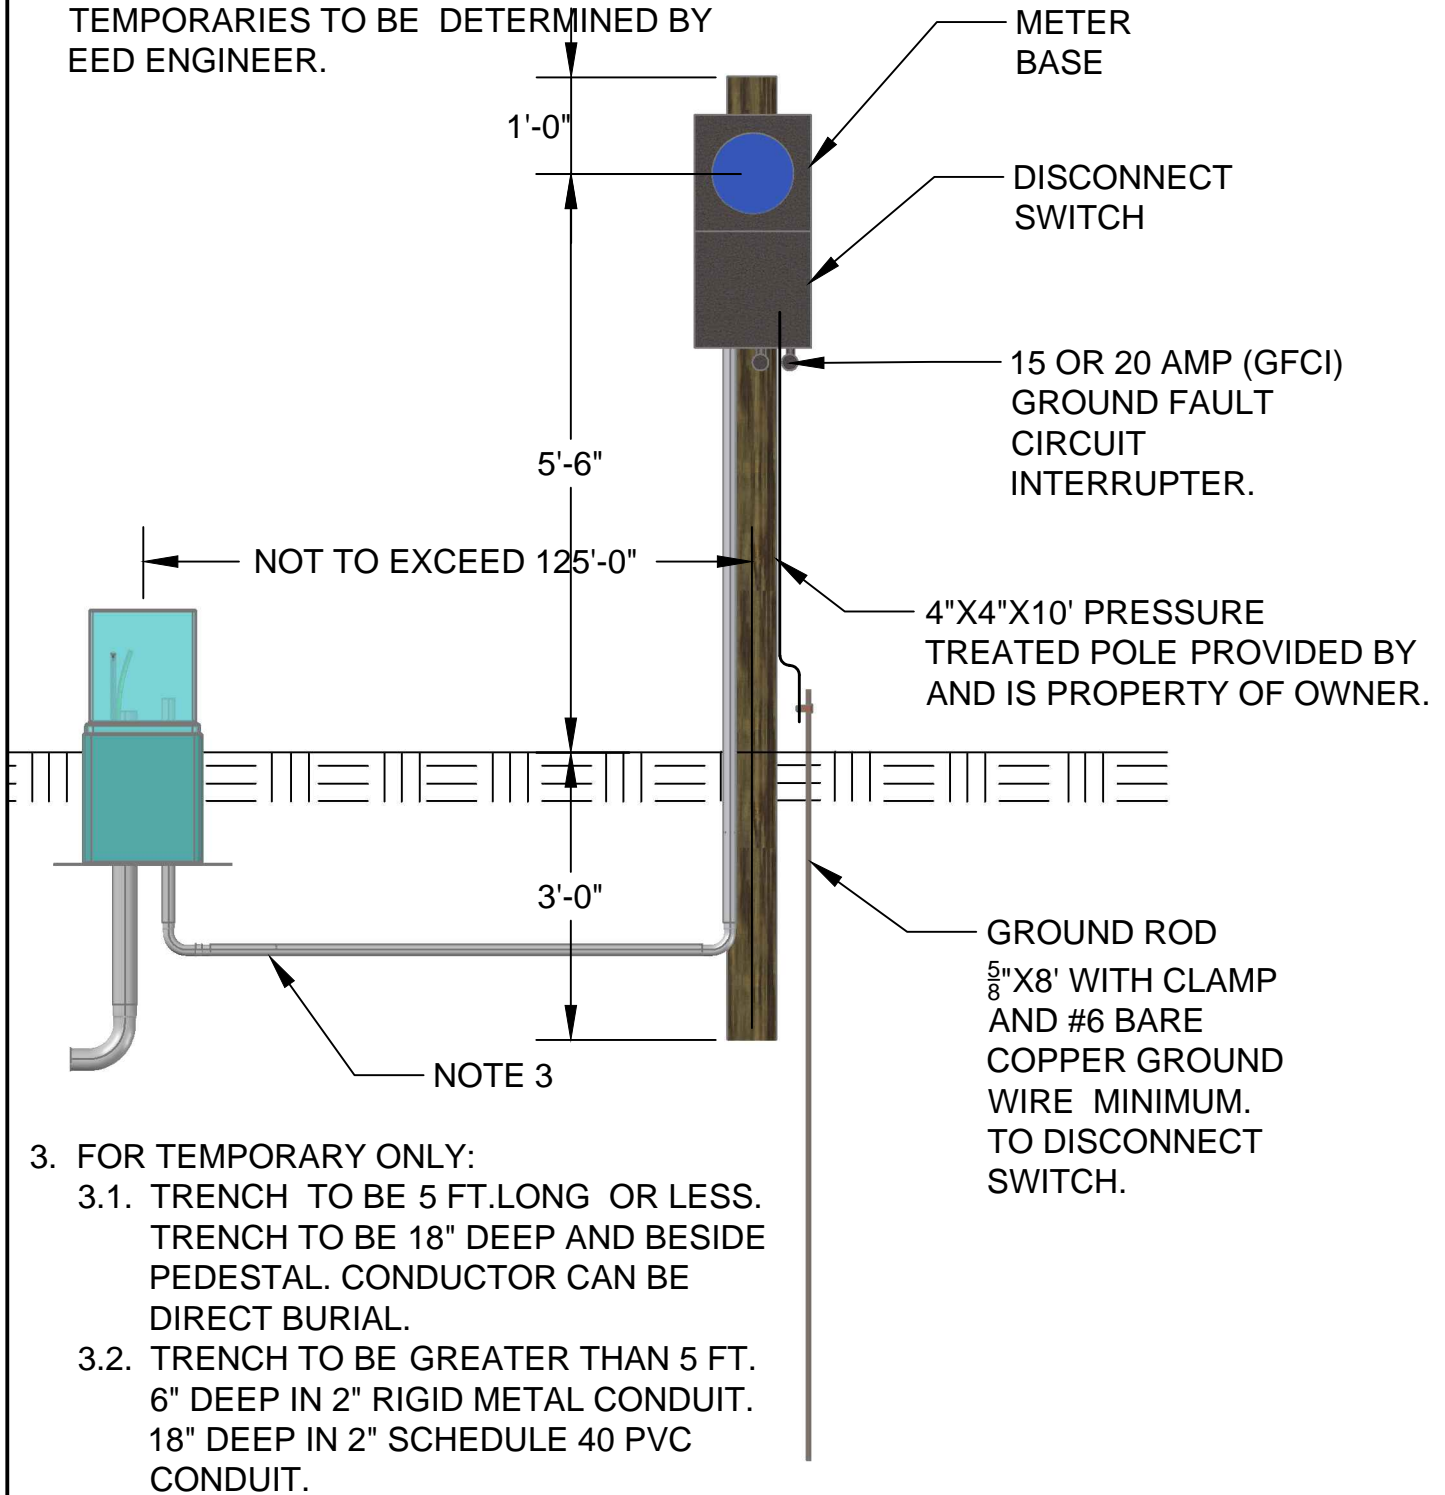

3. FOR TEMPORARY ONLY:
 - 3.1. TRENCH TO BE 5 FT.LONG OR LESS. TRENCH TO BE 18" DEEP AND BESIDE PEDESTAL. CONDUCTOR CAN BE DIRECT BURIAL.
 - 3.2. TRENCH TO BE GREATER THAN 5 FT. 6" DEEP IN 2" RIGID METAL CONDUIT. 18" DEEP IN 2" SCHEDULE 40 PVC CONDUIT.

COMPANY: ELIZABETHTON ELECTRIC DEPARTMENT					M8-8
DETAIL NAME: TEMPORARY UNDERGROUND SERVICE POLE CAN BE FROM PAD MOUNT TRANSFORMER OR PEDESTAL AS SHOWN					
DRAWN BY: J.E.S.	CHECKED BY:	DATE: 07-01-2010	PURPOSE: ASSEMBLY DETAIL	SCALE: 1/2"=1'-0"	PAGE: 8 OF PAGES: 11